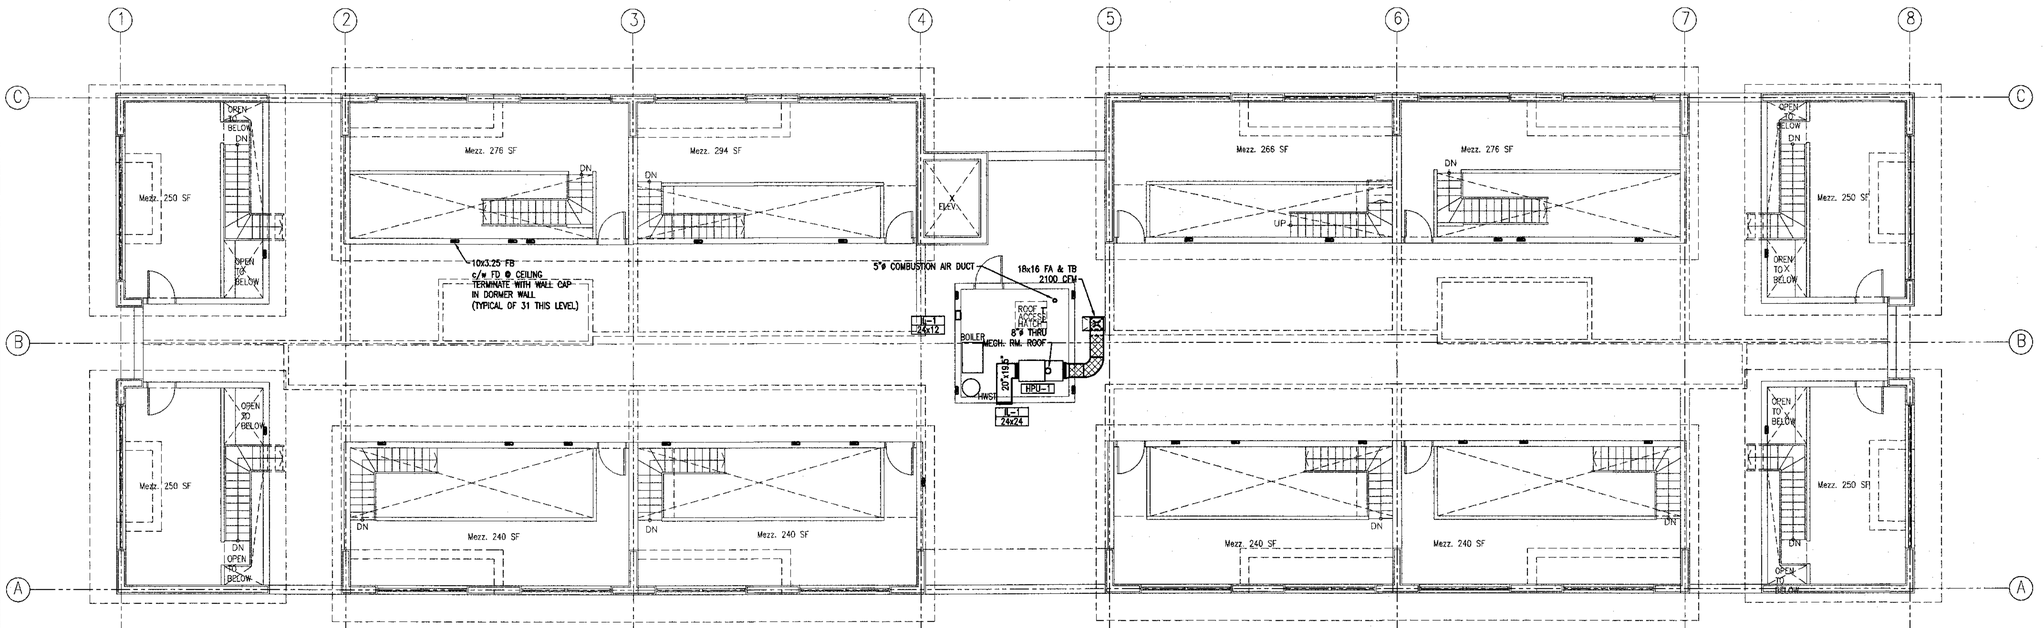

FOURTH FLOOR MEZZANINE PLAN

SCALE 1/8"=1'-0"

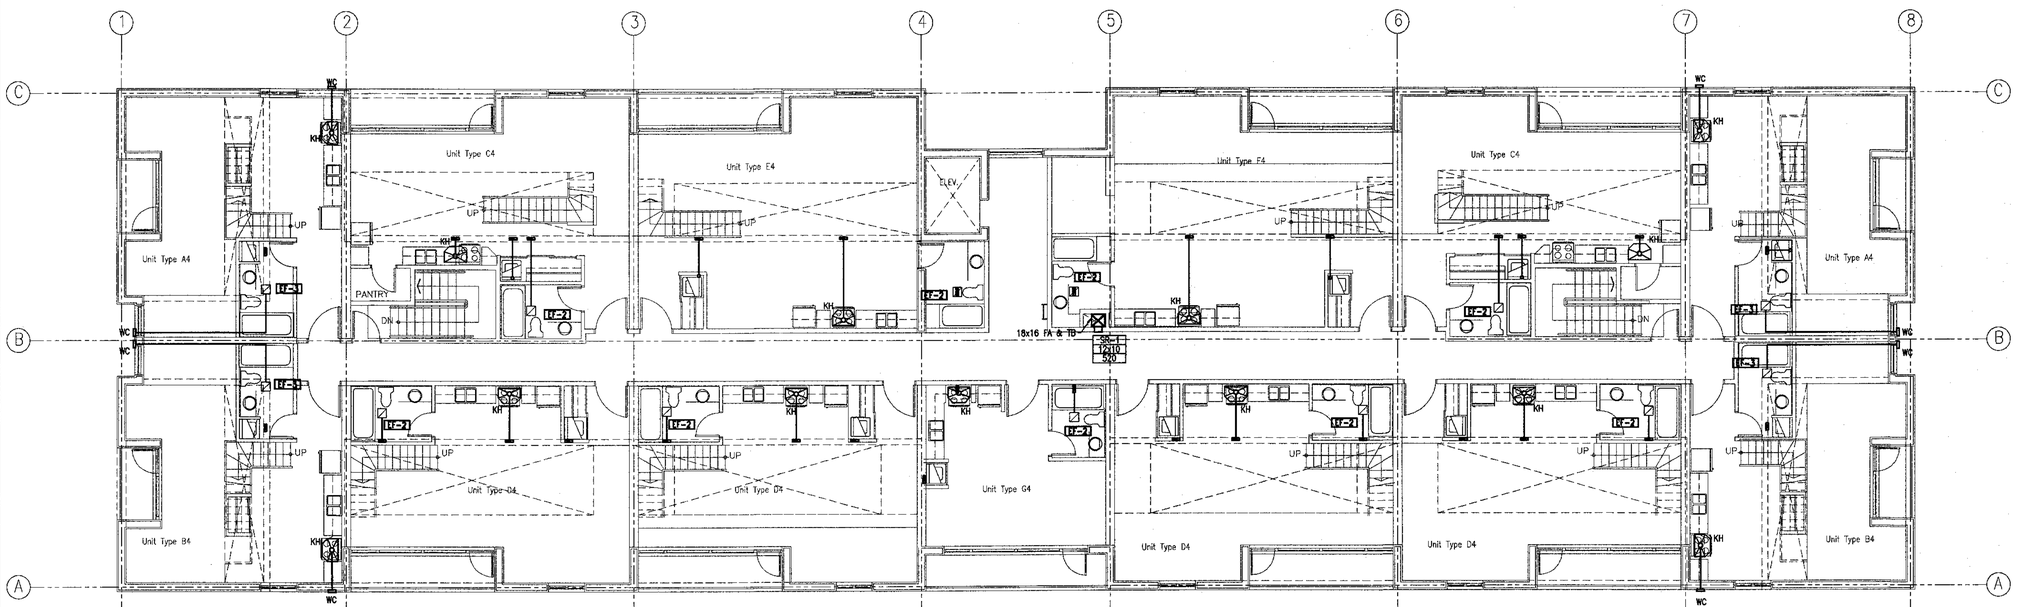

FOURTH FLOOR PLAN

SCALE 1/8"=1'-0"

LEGEND

	RECTANGULAR DUCT
	ROUND SOLID DUCT
	ROUND SOLID DUCT
	ACOUSTICALLY LINED DUCT
S	SENSOR
SR-1	LABEL
6x6	SIZE
200	CFM
EF	EXHAUST FAN
EG	EXHAUST GRILLE
FA	FROM ABOVE
FB	FROM BELOW
FD	FIRE DAMPER
HPU	HALLWAY PRESSURIZATION UNIT
TA	TO ABOVE
TB	TO BELOW
WC	WALL CAP

NOTE:

1. ALL KITCHEN EXHAUST DUCTS = 6"ø.
2. ALL WASHROOM EXHAUST DUCTS EF-1 = 4"ø
3. ALL WASHROOM EXHAUST DUCTS EF-2 = 5"ø
4. ALL WASHROOM EXHAUST DUCTS EF-3 = 5"ø.
5. ALL DRYER EXHAUST DUCTS = 4"ø
6. ALL EXHAUST DUCTS TO 10"x3.25" IN WALL DUCT, TERMINATE WITH WALL CAP UNLESS OTHERWISE SHOWN.
7. PROVIDE FD @ MEZZANINE CEILING PENTRATIONS.

NO.	DATE: (DDMMMYY)	DESCRIPTION
1	04NOV03	ISSUED FOR BUILDING PERMIT

AVALON MECHANICAL CONSULTANTS LTD.
#4 1322A Government Street
Victoria, B.C. V8W 1Y8
Telephone 384-4135
Fax 384-4134

JOB NAME: WILSON MANOR
109 WILSON ST., VICTORIA, B.C.

SHEET TITLE: FOURTH & MEZZANINE PLANS
HVAC

SCALE: AS NOTED
DESIGNED BY: M.D.
DRAWN BY: CJP
APPROVED BY: M.D.
DATE: (DDMMMYY) 26MAY03
JOB NO.: 203079

SHEET: 10 OF 11
DWG NO.: M-10

S:\CADD\203079 Wilson St\Drawings\M10-203079_HB3.dwg Friday, 7 November 2003 15:23 AMC PLUTTING SERVICES